
Environmental Status Report For Samri Bauxite Mine at

Post & Teh.: Samri, (Kusmi)
Dist: Balrampur-Ramanujganj (C.G.)

Duration: April-May-June-2021

Name of Industry:-



M/s. Hindalco Industries Limited.,

Name of Laboratory:-



QCI-NABET, MoEF & CC (GOI) ISO 9001:2015, ISO 14001:2015, ISO 45001:2018

60, Bajiprabhu Nagar, Nagpur - 440 033, MS Lab. & Consultancy: FP-34, 35, Food Park, MIDC, Butibori, Nagpur - 441122

Ph.: (0712) 2242077, 9373287475 Email: info@anacon.in, ngp@anacon.in website: www.anaconlaboratories.com

111.1

Foreword

The protection of environment plays a crucial role in maintaining the local environment

quality for any mining industry. Hence compliance of the statutory requirements becomes

very important to conserve the ecological balance within and surrounding the mine area.

Therefore, environment protection is becoming a prerequisite for sustainable

development. In line with this requirement, the management of M/s Hindalco Industries

Ltd. has adopted a corporate responsibility of environment protection.

In order to comply with the Environment protection act, to fulfill statutory requirement

and to be in tune with Environmental Preservation and sustainable development, M/s

Hindalco Industries Ltd. has retained ANACON LABORATORIES PVT. LTD., Nagpur

as Environment Consultants and for various Environmental issues related to their mines.

This report presents the Environmental Status for the period April-2021 to June-21 as

compliance to the statutory requirements.

The co-operation extended by the Staff and Management of M/s Hindalco Industries Ltd.

during the work execution period is gratefully acknowledged.

For ANACON LABORATORIES PVT. LTD.

Authorized Signatory

Place: Nagpur

Date : June, 2021



Introduction

1.1 Introduction

HINDALCO INDUSTRIES LIMITED (Hindalco) is one among the flagship companies of the Aditya Birla Group of Industries and is one of the largest corporate groups in India. This group is a leading manufacturer of Aluminum in India, having integrated facilities encompassing bauxite mining, refining and smelting to achieve Aluminium.

Various processing units of HINDALCO are strategically located in different parts of the nation to achieve optimum benefits. Over the past few decades the group has grown multifold in its production capacities, product mix and diversification in mining. HINDALCO possesses bauxite mine leases of Kudag, Samri and Tatijharia mines in Balrampur district of Chhattisgarh State.

HINDALCO INDUSTRIES LTD. awarded the work to M/s ANACON LABORATORIES PVT. LTD. Nagpur (ALPL) for carrying out Environmental monitoring of parameters for assessing pollution levels and preparation of monthly report (April-May-June-2021) as per the requirement of Chhattisgarh Environment Conservation Board (CECB) and Ministry of Environment, Forest and Climate Change (MoEF & CC) for Samri mining leases in Balrampur District, ChhattisgarhState.

1.2 Background Information of SamriMine

HINDALCO was granted Samri Bauxite mining lease over an area of 2146.746 hec in Samri, Dumarkholi, Gopatu villages in Post Office& Tehsil Samri (Kusmi) of Balrampur district, Chhattisgarh on 24/06/1998 for a period of 20 years. As per the Mines and Mineral (Development and Regulation) Amendment Act, 2015, Samri lease has been extended up to another 30 years i.e 23/06/2048. The mining operations were started on 25/05/1999. The production capacity of Samri Bauxite Mine is 5.0 Lakh Tone/Year.

1.3 Salient Features of Samri BauxiteMine

The deposits occur in Samri block, Post Office & Tahsil Samri(Kusmi) of Balrampur district. This deposit has been identified as one of the resources to cater the raw material requirements of the HINDALCO Alumina refinery at Renukoot, Uttar Pradesh. The salient features of the project are presented below: (Table-1)



Details of Salient Features

Table 1 Salient Features of Samri Bauxite Mines

SI.No.	Particulars	Details
1.	Survey of India Topo sheet No.	64 M /15
2.	Latitude	23° 23′ 02″N to 23° 27′ 05″N
3.	Longitude	83° 53′ 50″E to 83° 57′ 59″E
4.	Elevation	1140-m above Mean Sea Level
5.	Climatic Conditions (as per IMD, Ambikapur)	Annual maximum temperature: 30.3°C Annual minimum temperature: 17.7°C Average annual rainfall: 1401.1 mm
6.	Mining lease area	2146.746 hec.
7.	Method of mining	Open cast (Semi-Mechanized)
8.	Mode of transportation	Trucks
9.	Land use	Agricultural and Barren land
10.	Nearest Road	Samri to Kusmi (17 km)
11.	Nearest Airport	Ranchi (146.06 km, ESE)
12.	Nearest Town	Ambikapur (127 km, SW)

1.4 Environmental Monitoring

Regular monitoring of environmental parameters is of immense importance to assess the status of environment during mining operation. With the knowledge of baseline conditions, the monitoring program will serve as an indicator for any deterioration in environmental conditions due to mining operation of the project Suitable mitigation steps will be taken in time to safeguard the environment, based on monitoring reports. Monitoring is important in the control of pollution since the efficiency of control measures can only be determined by monitoring.

In order to find out the impact of mining activity on sensitive receptors, it is necessary to monitor Environmental Quality to know the level of concentrations of pollutants within and around the mining lease area. Accordingly Hindalco Industries through Anacon Laboratories Pvt. Ltd., Nagpur has been monitoring at following locations for air, water and Noise on monthly basis during these months (Table-2).

1.5 Air Environment

1.5.1 Ambient Air Quality Monitoring

Ambient Air Quality monitored at 8 locations in the core zone and buffer zone with reference to Samri mine lease area as shown in (Fig. 1).



Details of Salient Features

Table: 2 Locations of Ambient Air Quality Monitoring (AAQM) & Fugitive Emission (2146.746 hec.)

SI. No.	Core zone	SI. No.	Buffer zone
1	Samri-Gopatu/Near Weigh Bridge	5	Sairaidh Campus
2	Rajendrapur/Near Mining Area	6	Virhorepat Village
3	Kutku Village/Near V.T.Center	7	Tatijharia Village/Near Weigh Bridge
4	Dumerkholi/Near Mining Area	8	Piprapat/Near Mining Area

The sampling stations are selected at the above mentioned locations, in downwind and upwind directions of the mining site in the core zone and buffer zone. Anacon Laboratories Pvt. Ltd., Nagpur is carrying out regular monitoring for PM₁₀, PM_{2.5}, SO₂, NO₂, CO and Pb, Hg, As & Cr at above Ambient Air Quality Monitoring (AAQM) locations for the Month of April-May-June-2021.

1.5.2 Sampling Duration and Frequency

Ambient air quality monitoring was carried out for the parameters PM_{10} , $PM_{2.5}$, SO_2 , NO_2 , CO and Pb, Hg, As and Cr from April-2021 to June-2021 as per CPCB norms.

Data is compared with the present revised standards mentioned in the latest Gazette Notification of the Central Pollution Control Board (CPCB) (November- 18, 2009), and as per consent conditions mentioned in consent letter.

1.5.3 MONITORED PARAMETERS AND FREQUENCY OF SAMPLING

Methods and Instruments used for Sampling

The air samples were analyzed as per methods specified by Central Pollution Control Board (CPCB).

The levels of Particulate Matter (PM_{10}), Sulphur Dioxide (SO_2 ,), Oxides of Nitrogen (NO_2), Carbon Dioxide (CO), Pb, Hg, As and Cr were monitored for establishing the baseline status. PM_{10} was collected with the help of Respirable particulate sampler operating 24 hours by drawing air which passes through the cyclone at the rate of 1.0 -1.3 m³/min which collects the particles less than 10 μ m diameter over glass fiber filter paper. The dust deposited over the filter paper is measured as PM_{10} and the smaller particulates from $PM_{2.5}$ are collected into the membrane filter paper.



Details of Salient Features

The measurement techniques used for various pollutants and other details are given in **(Table3)**.

Table 3

MONITORED PARAMETERS AND FREQUENCY OF SAMPLING

Parameters	Sampling frequency
Particulate Matter (PM ₁₀)	24 hourly sample twice a week for Three months
Particulate Matter (PM _{2.5})	24 hourly sample twice a week for Three months
Particulate Matter 2.5	24 hourly sample twice a week for Three months
Sulphur dioxide (SO ₂)	24 hourly sample twice a week for Three months
Oxides of Nitrogen (NO ₂)	24 hourly sample twice a week for Three months
CO, Pb, Hg, As, Cr	8 hourly samples for 24 hour twice a week for three months

Table 4.0

Measurement Techniques for various pollutants

Sr. No.	Parameter	Technique	Technical Protocol	Minimum Reportable Value(µg/m³)
1.	Particulate Matter PM ₁₀	Respirable Dust Sampler (Gravimetric Method)	IS-5182 (Part-23)	5
2.	Particulate Matter PM _{2,5}	Respirable Dust Sampler (Gravimetric Method)	USEPA-40 (Part-50)	5
3,	Sulphur Dioxide	Modified West and Gaeke	IS-5182 (Part - II)	4
4.	Oxide of Nitrogen	Jacob &Hochheiser Method	IS-5182 (Part - VI)	4
5.	Carbon Monoxide	NDIR Spectroscopy	IS-5182 (Part - X)	2
6.	Pb, As, Hg, Cr	Acid Digestion Method	EPA Method	0.1



Details of Salient Features

1.6 Meteorology: Wind Pattern

The data of wind pattern collected during the study period (April-May-June-2021) indicates that the wind was blowing predominately from (WSW and W) directions, during study period.

Wind Frequency Distribution Data

Sr. No.	Directions / Wind Classes (m/s)	0.5 - 2.1	2.1 - 3.6	3.6 - 5.7	5.7 - 8.8	8.8 - 11.1	>= 11.1	Total (%)
1	348.75 - 11.25	0.025195	0.036189	0.011452	0.015117	0.000458	0.000000	0.088410
2	11.25 - 33.75	0.013743	0.009162	0.003665	0.003207	0.000458	0.000000	0.030234
3	33.75 - 56.25	0.011910	0.009620	0.003207	0.000000	0.000000	0.000000	0.024737
4	56.25 - 78.75	0.007787	0.009162	0.000000	0.000000	0.000000	0.000000	0.016949
5	78.75 - 101.25	0.006413	0.012826	0.000458	0.000000	0.000000	0.000000	0.019698
6	101.25 - 123.75	0.006413	0.006871	0.000000	0.000000	0.000000	0.000000	0.013284
7	123.75 - 146.25	0.010078	0.005955	0.000916	0.000000	0.000000	0.000000	0.016949
8	146.25 - 168.75	0.009162	0.015575	0.002290	0.000000	0.000000	0.000000	0.027027
9	168.75 - 191.25	0.016949	0.018323	0.013743	0.002749	0.000000	0.000000	0.051764
10	191.25 - 213.75	0.012368	0.033898	0.009620	0.004581	0.000000	0.000000	0.060467
11	213.75 - 236.25	0.018323	0.031608	0.032982	0.008704	0.000000	0.000000	0.091617
12	236.25 - 258.75	0.017407	0.050847	0.041686	0.016949	0.000000	0.000000	0.126890
13	258.75 - 281.25	0.017865	0.032982	0.035731	0.014659	0.000000	0.000000	0.101237
14	281.25 - 303.75	0.016949	0.027943	0.041686	0.011910	0.000916	0.000000	0.099404
15	303.75 - 326.25	0.018781	0.035273	0.029776	0.005955	0.000916	0.000458	0.091159
16	326.25 - 348.75	0.023362	0.063674	0.033898	0.005497	0.002290	0.004123	0.132845
	Sub-Total	0.232707	0.399908	0.261109	0.089327	0.005039	0.004581	0.992216
	Calms							0.007326
	Missing/Incomplete	ė		J. Turk				0.000458
	Total							1.000000

Summary of Wind Pattern

Season	First Pre-Dominant	Second Pre-Dominant	Calm	Average Wind
	Wind Direction	Wind Direction	Condition	Speed
April-May-June-2021	WSW (12.7%)	W (10.1%)	0.73	3.29 m/s



Details of Salient Features

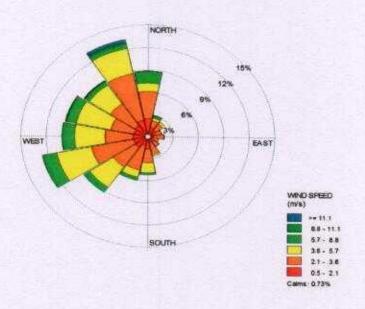


Figure.01: Wind Rose Diagram (April-May-June-2021)

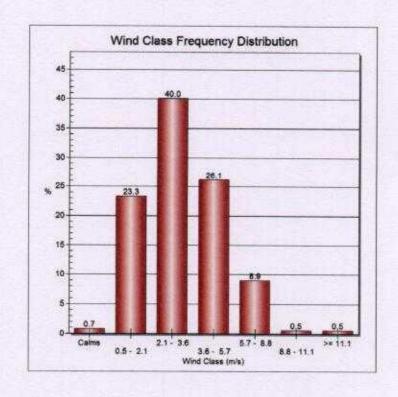


Figure.02: Wind Class Frequency Distribution (April-May-June-2021).



Details of Salient Features

MONITORED PARAMETERS AND FREQUENCY OF SAMPLING

1.7 Methods and Instruments used for Sampling

The air samples were analyzed as per methods specified by Central Pollution Control Board (CPCB). The levels of Particulate Matter (PM10), Sulphur Dioxide (SO2), Oxides of Nitrogen (NOx), Carbon Monoxide (CO), Pb, Hg, As and Cr were monitored for establishing the baseline status. PM10 was collected with the help of Respirable Particulate Sampler operating 24 hours by drawing air which passes through the cyclone at the rate of 1.0 -1.3 m³/min which collects the particles less than 10 μ m diameter over glass fibre filter paper. The dust deposited over the filter paper is measured as PM10 and the smaller particulates from 2.5 μ m are collected into the Membrane Filter Paper. The dust fall rate was measured using dust fall jar. The jar was exposed for one month in the mining area and Samri-Gopatu during pre and post monsoon period. The jar was filled with 2 lit of distilled water. The water in the jar is mixed with copper sulphate solution (0.02 N solutions) to prevent any growth of algae. The water level in the jar is constantly maintained in such a way that 2 lit of water is always retained. The measurement techniques used for various pollutants and other details are given in (Table 3).

Earmarked samples were collected for Particulate Matter-PM₁₀, Particulate Matter-PM_{2.5}, SO₂ and NO_X for 24 hourly and CO 8 hourly. Collected samples were sent to Laboratories for analysis.

Table 3.0

SI. No.	Parameter	Technique	Technical Protocol	Minimum ReportableValue (µg/m³)	
1.	Respirable Particulate Matter	Respirable Dust Sampler (Gravimetric Method)	IS-5182 (Part-23)	5	
2.	Particulate Matter 2.5	Respirable Dust Sampler (Gravimetric Method)	Gravimetric Method	5	
3.	Sulphur Dioxide	Modified West and Gaeke	IS-5182 (Part - II)	4	
4.	Oxide of Nitrogen	Jacob &Hochheiser Method	IS-5182 (Part - VI)	4	
5.	Carbon Monoxide	NDIR Spectroscopy	IS-5182 (Part - X)	2	
6.	Pb, As,Hg, Cr	Acid Digestion Method	EPA Method	0.1	



Details of Salient Features

Table 4

Statistical Analysis

Location	Month &Year	PM-10 (µg/m ³)	PM-2.5 (μg/m ³)	SO ₂ (μg /m ³)	NO ₂ (μg /m ³)	CO (mg/m ³)	Рь (µg/m ³)	Hg (μg/m ³)	As (ng/m ³)	Cr (µg/m³)
Core Zone			FUNE							
	April-2021	58,9	29.6	8.7	17.9	0.295	0.015	ND	ND	ND
Samri-Gopatu/	May-2021	65.7	24.1	10.0	19.1	0.301	0.018	ND	ND	ND
Nr.weigh bridge	June-2021	51.3	19.6	8.1	14.6	0.220	ND	ND	ND	ND
	April-2021	62.2	33.5	9.1	18.3	0.298	0.017	ND	ND	ND
Rajendrapur/	May-2021	61.3	22.5	9,2	16.2	0,300	0.017	ND	ND	ND
Nr.Mining Area	June-2021	50,6	20.1	8.2	15.5	0.240	0.015	ND	ND	ND
ALE TO	April-2021	63.4	31.7	9.6	19.2	0.195	ND	ND	ND	ND
Kutku Village/	May-2021	59.3	20.1	9.0	18.6	0.285	0.017	ND	ND	ND
Nr.V.T. Center	June-2021	50.5	21.3	8.0	15.6	0.209	ND	ND	ND	ND
	April-2021	68.5	41.2	10,5	19.1	0.263	0.017	ND	ND	ND
Dumerkholi/Nr.	May-2021	60.9	20.4	9.0	18.7	0.284	0.017	ND	ND	ND
Mining Area	June-2021	53.1	22.2	7.8	16.6	0.215	0.015	ND	ND	ND
CPCB Sta	ndards	100 (24 hrs)	60 (24 hrs)	80 (24 hrs)	80 (24 hrs)	2 (8 hrs)	1.0 (24 hrs)	-	6.0 (annual)	
Minim	um	50.5	19.6	7.8	14.6	0.195	0.015			
Maxim	um	68.5	41.2	10.5	19.2	0.301	0.018		-	
Averag	ge	58.3	25.5	8.9	17.5	0.259	0.016			
98% 1	e	67.9	39.5	10.4	19.2	0.301	0.018			

- The Average Concentration of PM₁₀ within the Core Zone of Samri Lease is 58.3 μg/m³.
- The Average Concentration of PM₂₅ within the Core Zone of Samri Lease is 25.5 μg/m³.
- The Average Concentration of SO₂within the Core Zone of Samri Lease is 8.9 µg/m³.
- The Average Concentration of NO₂ within the Core Zone of Samri Lease is 17.5 μg/m³.
- The Average Concentration of CO within the Core Zone of Samri Lease is 0.259 μg/m³.
- The Average Concentration of Pb within the Core Zone of Samri Lease is 0.016 µg/m³.

Conclusion:-The Average Concentration within the Core Zone of Samri Lease during this period (April-May-June-2021). It is within permissible limits as per CPCB Standards.



Details of Salient Features

Location	Month & Year	PM-10 (µg/m ³)	PM-2.5 (μg/m ³)	SO ₂ (μg /m ³)	NO ₂ (μg/m ³)	CO (mg/m ³)	РЬ (µg /m ³)	Hg (μg/m ³)	As (ng/m ³)	Cr (µg /m³
Buffer Zone										7,04
Sairaidh Campus Tatijharia Village/Nr. Weigh Bridge Piprapat/ Nr.Mining Area Virhorepat Village	April-2021	60.9	25.9	7.5	17.5	0.307	0.017	ND	ND	ND
	May-2021	51.0	18.3	7.6	16.8	0.198	0.014	ND	ND	ND
	June-2021	50.8	19.7	7.2	20.6	0.199	ND	ND	ND	ND
Village/Nr.	April-2021	59.2	20.9	9.0	20.3	0.240	0.019	ND	ND	ND
	May-2021	52.9	20.5	7.3	21.2	0.246	0.018	ND	ND	ND
Weigh Bridge	June-2021	50.8	19.7	7.2	20.6	0.182	0.015	ND	ND	ND
Piprapat/	April-2021	58.4	20.7	9.5	17.9	0.224	0.020	ND	ND	ND
	May-2021	60.1	24.4	8.6	22.6	0.218	0.017	ND	ND	ND
Area	June-2021	55.5	25.3	8.9	23.7	0.212	0.016	ND	ND	ND
18.00 A	April-2021	57.8	21.3	8.1	19.3	0.215	0.017	ND	ND	ND
LANGUE DE LA CONTRACTOR	May-2021	58.3	25.6	9.2	23.7	0.165	0.017	ND.	ND	ND
vimage	June-2021	49.5	21.1	7.8	21.6	0.154	ND	ND	ND	ND
CPCB Sta	ndards	100 (24 hrs)	60 (24 hrs)	80 (24 hrs)	80 (24 hrs)	2 (8 hrs)	1.0 (24 hrs)	#	6.0 (annual)	77
Minim	um	49.5	18,3	7.2	16.8	0.154	0.014	janjula		-
Maxim	um	60.9	25.9	9.5	23.7	0.307	0.020			
Avera	ge	55.4	22.0	8.2	20.5	0.213	0.017	Name .		
98%	le	60.7	25.8	9.4	23,7	0.294	0.020	200		

- The Average Concentration of PM₁₀ within the Buffer Zone of Samri Lease is 55.4 μg/m³.
- The Average Concentration of PM2swithin the Buffer Zone of Samri Lease is 22.0 µg/m³.
- The Average Concentration of SO₂ within the Buffer Zone of Samri Lease is 8.2 µg/m³.
- The Average Concentration of NO₂ within the Buffer Zone of Samri Lease is 20.5 μg/m³.
- The Average Concentration of CO within the Buffer Zone of Samri Lease is 0.213 µg/m³.
- The Average Concentration of Pb within the Buffer Zone of Samri Lease is 0.017µg/m³.

Conclusion: - The Average Concentration within the Buffer Zone of Samri Lease during this period (April-May-June-2021). It is within permissible limits as per CPCB Standards.



Details of Salient Features

Month-wise Summary of Statistical Analysis

1.8. Samri Lease (Core Zone):-

1.8.1 Ambient Air Quality:

Ambient air quality has been generated as per NAAQS 2009 for the month of April-May-June-2021. PM₁₀, PM_{2.5}, SO₂, NO₂ & CO. The values obtained were then compared vis-a-visthe standards prescribed by CPCB for Industrial/ Rural / Residential uses.

Presentation of Results:

The summary of Ambient Air Quality monitoring results from April-2021 to June - 2021 are presented in detail in Table 4.0.98th percentile; maximum and minimum values etc. have been computed from the collected raw data for all the AAQ monitoring station. The data has been compared with the standards prescribed by Central Pollution Control Board (CPCB)/NAAQS for residential and rural zone.

A Particulate Matter-PM₁₀:

The minimum and maximum concentrations for Particulate Matter- PM_{10} were recorded as 50.5 $\mu g/m^3$ and 68.5 $\mu g/m^3$ at Kutku Village/ Nr.V.T. Center and Dumerkholi/Nr. Mining Area location respectively. The average concentration of PM_{10} was 58.3 $\mu g/m^3$.

B. ParticulateMatter-PM_{2,5}:

The minimum and maximum concentrations for Particulate Matter-PM_{2.5} were recorded as 19.6 µg/m³ & 41.2µg/m³ at Samri-Gopatu/Nr. weigh bridge and Dumerkholi/Nr. Mining Area location. The average concentration of PM_{2.5} was 25.5µg/m³.

C. Sulphur Dioxide (SO₂):

The minimum and maximum for SO_2 concentrations were recorded as $7.8\mu g/m^3$ and $10.5\mu g/m^3$ respectively. The minimum & maximum concentration was recorded at Dumerkholi/Nr. Mining Area location. The average concentration of SO_2 was $8.9\mu g/m^3$.

D. Nitrogen Dioxide (NO₂):

The minimum and maximum for NO_2 concentrations were recorded as $14.6\mu g/m^3$ and $19.2\mu g/m^3$. The minimum concentration was recorded at Samri-Gopatu/Nr. weigh bridge and maximum concentration was also recorded at Kutku village location. The averageconcentration of NO_X was $17.5\mu g/m^3$.

E. Carbon Monoxide (CO):

The minimum and maximum for CO concentrations were recorded as 0.195 mg/m³ and 0.301 mg/m³. The minimum concentration was recorded at Kutku village and maximum concentration was also recorded at Samri-Gopatu/Nr. weigh bridge location. The averageconcentration of CO was 0.259 mg/m³.



Details of Salient Features

F. Lead (Pb):

Maximum Lead detected in PM_{10} samples was $0.018~\mu g/m^3 at$ Samri-Gopatu/Nr. weigh bridge location.

No lead could be detected in PM_{2.5}samples at any of the Ambient Air samples at any of the locations.

G. Mercury(Ha):

Mercury was not detected at any of the locations in PM_{10} samples as well as $PM_{2.5}$ Samples.

H Arsenic (As):


Arsenic was not detected at any of the locations in PM_{10} samples as well as $PM_{2.5}$ Samples.


L Chromium(Cr):


Chromium was not detected at any of the locations in PM_{10} samples as well as $PM_{2.5}$ Samples.



Details of Salient Features

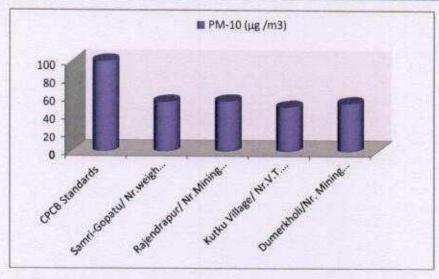


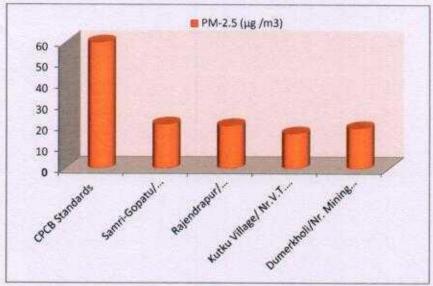


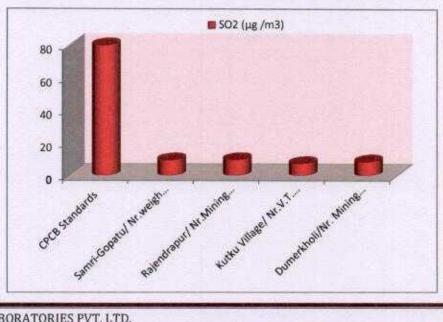




Details of Salient Features

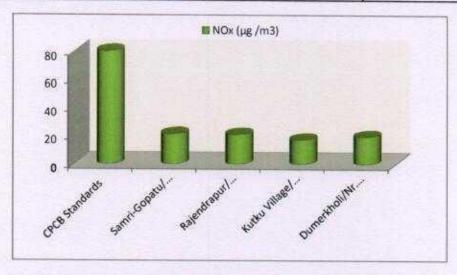

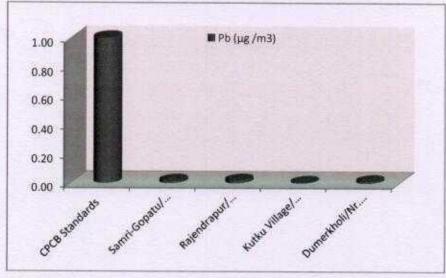

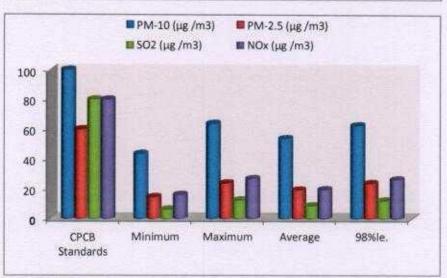



Details of Salient Features

1.9. Samri Lease (Buffer Zone):-

1.9.1 Ambient Air Quality:

Ambient air quality has been generated as per NAAQS 2009 for the month of April-May-June-2021. PM₁₀, PM_{2.5}, SO₂,NO₂ & CO, The values obtained were then compared vis-a-visthe standards prescribed by CPCB for Industrial/Rural / Residential uses.

1.9.2 Presentation of Results:

The summary of Ambient Air Quality monitoring results from April- 2021 to June- 2021 are presented in detail in Table 4.0. 98th percentile; maximum and minimum values etc. have been computed from the collected raw data for all the AAQ monitoring station. The data has been compared with the standards prescribed by Central Pollution Control Board (CPCB)/NAAQS for residential and rural zone.

A. Particulate Matter-PM₁₀:

The minimum and maximum, both concentrations for Particulate Matter-PM $_{10}$ were recorded as 49.5 $\mu g/m^3$ and 60.9 $\mu g/m^3$ at Virhorepat village & Sairaidh campus. The average concentration of PM $_{10}$ was 55.4 $\mu g/m^3$.

B. Particulate Matter-PM_{2.5}:

The minimum and maximum concentrations for Particulate Matter-PM_{2.5} were recorded as 18.3μg/m³ & 25.9μg/m³ at Sairaidh campus location respectively. The average concentration of PM_{2.5} was 22.0μg/m³.

C. Sulphur Dioxide (SO₂):

The minimum and maximum for SO_2 concentrations were recorded as 7.2 $\mu g/m^3$ and 9.5 $\mu g/m^3$ respectively. The minimum concentration was recorded at Sairaidh campus and maximum concentration was also recorded at Piprapat/Nr. mining area location. The average concentration of SO_2 was 8.2 $\mu g/m^3$.

D. Nitrogen Dioxide (NO₂):

The minimum and maximum for NO_X concentrations were recorded as 16.8 $\mu g/m^3$ and 23.7 $\mu g/m^3$. The minimum concentration was recorded at Sairaidh campus and maximum concentration was also recorded at Piprapat/Nr. mining area location. The average concentration of NO₂ was 20.5 $\mu g/m^3$.



Details of Salient Features

E. Carbon Monoxide (CO):

The minimum and maximum for CO concentrations were recorded as 0.154 mg/m³and 0.307 mg/m³. The minimum concentration was recorded at Virhorepat village and maximum concentration was also recorded at Sairaidh campus location. The average concentration of CO was 0.213 mg/m³.

F. Lead (Pb):

Maximum Lead detected in PM_{10} samples was 0.020 $\mu g/m^3$ at Piprapat/Nr. mining area.

No lead could be detected in PM_{2.5} samples at any of the Ambient Air samples at any of the locations.

G. Mercury(Ha):

Mercury was not detected at any of the locations in PM_{10} samples as well as $PM_{2.5}$ Samples.

H. Arsenic (As):


Arsenic was not detected at any of the locations in PM₁₀ samples as well as PM_{2.5} Samples.


I. Chromium(Cr):


Chromium was not detected at any of the locations in PM₁₀ samples as well as PM_{2.5} Samples.



Details of Salient Features

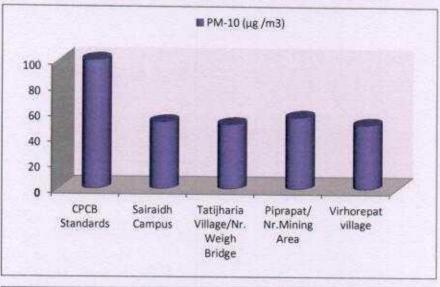


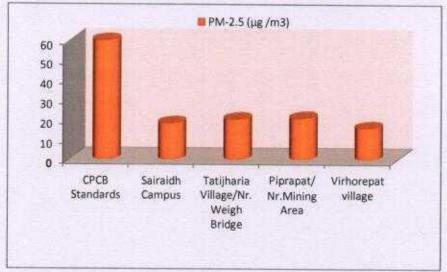


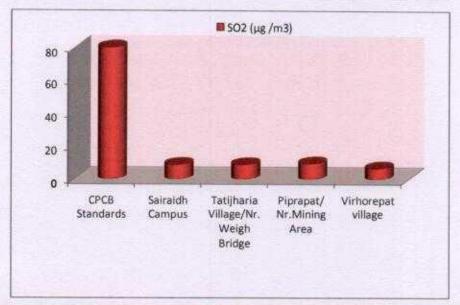




Details of Salient Features

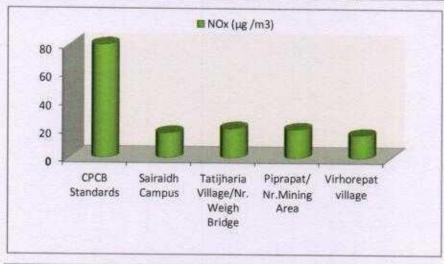

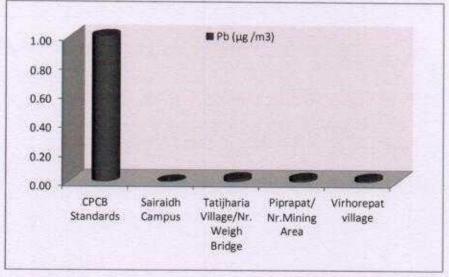

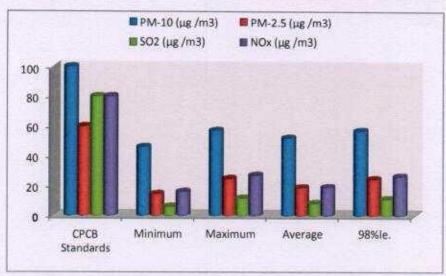



Details of Salient Features

Noise Environment:

The Director General of Mines Safety in its circular No. DG (Tech)/18 of 1975, has prescribed the noise level in mining occupations (TLV) for workers, in an 8 hour shift period with unprotected ear as 90 dB(A) or less. There will be some noise sources in mines, which produce noise levels above 90 dB(A), however, the workers are not expected to be exposed continuously for 8 hours. In order to maintain this statutory requirement Noise monitoring has been carried out in and around the mining lease area.

Work zone noise level in the mining area shall increase due to blasting and excavation, transportation. The impacts due to the mining activities on the noise levels shall be negligible, if all the precautions for the elimination of the noise are taken. The mining activities will be undertaken during daytime only. The daytime equivalent noise levels, when all the machineries are in operation, shall be minimized as if machineries have been provided with noise control equipment. Noise monitoring is carried out on monthly basis at three locations in each month are shown in **Fig. 3**.

Identification of sampling locations

Noise at different noise generating sources has been identified based on the activities in the village area and ambient noise due to traffic.

The noise monitoring has been conducted for determination of ambient noise levels in the mining area and villages. The noise levels at each location were recorded for 24hours.

Instrument used for monitoring

Noise levels were measured using integrated sound level meter Model no.SL-HTC-1352. This instrument is capable of measuring the Sound Pressure Level (SPL), Leq.

Method of Monitoring

Sound Pressure Level (SPL) measurements were monitored at three locations. The readings were taken for every hour for 24 hours. The day noise levels have been monitored during 6 am to 10 pm and night levels during 10 pm to 6 am at three locations within 10-km radius of the study area.

Noise level monitoring was carried out continuously for 24 hours with one hour interval starting at 06.00 hrs to 06.00 hrs next day. Noise levels monitored during day and night at 3 locations are found to be below the stipulated standard of CPCB for Industrial area as 75dB(A) and 70dB(A) for day and night respectively.



Details of Salient Features

Table 5

Noise Emission Monitoring Report

SR. NO.	LOCATION	Month	Noise	e-dB(A)
DICTIO.	LOCATION	Month	Day Time	Night Time
Core Zone				
	6	April-2021	62.9	57.6
1.	Samri-Gopatu/ Near Weigh bridge	May-2021	63.1	56.4
	near meight prinage	June-2021	56.8	43.9
2.	Rajendrapur/ Nr. Mining Area	April-2021	58.1	46.2
		May-2021	56.3	51.6
	777.00	June-2021	52.1	38.7
Buffer Zo	ne		10.0	
Buffer Zoi	Tatijharia Village/Nr. Weigh Bridge	April-2021	51.7	48.3
		May-2021	54.7	49.2
		June-2021	53.1	47.6
Buffer Zor		April-2021	62.4	53.6
2.	Piprapat/Nr. Mining Area	May-2021	61.8	51.9
		June-2021	58,3	52.7
CPCB Sta	ndards			
Industrial	Area		75	70
Residentia	al area		55	45

<u>Conclusion:</u> The Noise Monitoring Results at Samri Lease during this period (April-May-June-2021), it is within permissible limits as per CPCB Standards.

Table 5.1

HEMM Spot Noise Level Monitoring

Unit:	dB(A)	Leq.

SI. No.	Location		April-2021		May-2021		21
	Location	Min.	Max.	Min.	Max.	Min.	Max.
1.	Samri-Gopatu/ Near Weigh bridge	58.3	67.2	61.4	68.3	57.3	61.4
2.	Near Mining Area	62.9	71.4	56.2	67.9	59.1	64.2



Details of Salient Features

2.0 Water Quality:

The existing status of water quality for groundwater and surface water was assessed by collecting the water samples from underground wells from the village Samri, Kudag, Tatijhariya, Saraidih, Rajendrapur and surface water sample from Nallahs nearby Samri mines. The physico-chemical analysis of water samples collected during study period reported as average of three months given in (Table 6). The overall water quality found to be below the stipulated standards of IS 10500-2012 for ground water & found to be fit for drinking purpose for tested parameters. Surface water quality is satisfactory as per IS: 10500-2012. Thus the impacts due to mining activities in each month have been found to being significant.



Details of Salient Features

Table 6 Report on Chemical Examination of Ground Water (May-2021)

Location:	GW1) Samari Weigh Bridge
cocation.	Sample Source:-Borewell Water

TEST RESULTS

						Page 1 of 4
S.N.	Test Parameter	Measurement Unit	Test Method	Requir IS 10 (Drinking Water) Including A	Test Result	
				Acceptable Limit	Permissible Limit #	
1	Biological Testing 1. Water		Annual Control of the	-	Lamit w	
1	Total coliform	Per 100 ml	IS 15185 : 2016	Absent	Absent	Absent
2	Escherichia coli	Per 100 ml	IS 15185 ; 2016	Absent	Absent	Absent
п	Chemical Testing 1. Water					
3	Alkalinity (as CaCO:)	mg/l	IS 3025 (Part 23): 1986	200	600	116.24
4	Ammonia (as N)	mg/l	IS 3025 (Part 34): 1988	0.5	No relaxation	BDL (DL - 0.1)
5	Anionic surface active agents (as MBAS)	mg/l	IS 13428 : 2005 Annex K	0.2	1.0	BDL (DL - 0.01)
6	Colour	Hazen units	IS 3025 (Part 4): 1983	5	15	
7	Cyanide (as CN)	mg/l	IS 3025 (Part 27): 1986	0.05	No relaxation	BDL (DL - 0.005)
8	Chloride (as Cl)	mg/l	IS 3025 (Part 32) :1988	250	1000	26.41
9	Calcium (as Ca)	mg/l	IS 3025 (Part 40): 1991	75	200	32.68
10	Chloramines (as Cl ₂)	mg/l	IS 3025 (Part 26): 1986	4,0	No relaxation	BDL (DL - 0.1)
11	Free residual chlorine	mg/l	IS 3025 (Part 26): 1986	Min. 0.2		BDL (DL - 0.1)
12	Fluoride (as F)	mg/l	IS 3025 (Part 60) : 2008	1.0	1.5	0.16
14	Magnesium (as Mg)	mg/l	IS 3025 (Part 46): 1994	30	100	11.52
15	Nitrate (as NO ₁) Odour	mg/l	APHA 23rd Edition	45	No relaxation	BDL (DL - 2)
16	pH		IS 3025 (Part 5): 2018	Agreeable	Agreeable	Agreeable
17	- Accommodate to the control of the		IS 3025 (Part 11): 1983	6.5 to 8.5	No relaxation	7.62 at 25°C
18	Phenolic compounds (as C ₂ H ₂ OH)	mg/l	IS 3025 (Part 43): 1992	0.001	0.002	BDL (DL - 0.001)
19	Sulphate (as SO ₄)	mg/l	IS 3025 (Part 24): 1986	200	400	15.43
20	Sulphide (as H ₂ S) Taste	mg/l	IS 3025 (Part 29): 1986	0.05	No relaxation	BDL (DL - 0.03)
21	Total dissolved solids		IS 3025 (Part 8): 1984	Agrecable	Agrecable	Agreeable
22	Turbidity	mg/l	IS 3025 (Part 16): 1984	500	2000	286
23	Total hardness (as CaCO:)	NTU	IS 3025 (Part 10) : 1984	1	5	0.4
24	Mineral Oil	mg/l	IS 3025 (Part 21) : 2009	200	600	129.01
II	Chemical Testing	mg/l	ANgr RES-40	0.5	No relaxation	BDL (DL - 0.001)
88.6	2. Residues In Water					
25	Arsenic (as As)	mg/l	IS 3025 (Part 37): 1988	0.01	No relaxation	BDL (DL - 0.01)
26	Aluminium (as Al)	mg/l	IS 3025 (Part 2): 2019	0.03	0.2	BDL (DL - 0.01)
27	Barium (as Ba)	mg/l	IS 3025 (Part 2): 2019	0.7	No relaxation	BDL (DL - 0.01)
28	Boron (as B)	mg/l	IS 3025 (Part 2) : 2019	0.5	-	
29	Copper (as Cu)	mg/l	IS 3025 (Part 2) : 2019	0.05	2.4	BDL (DL - 0.1)
30	Cadmium (as Cd)		The state of the s		1.5	BDL (DL - 0.03)
31	Iron (as Fe)	mg/l	IS 3025 (Part 2) : 2019	0.003	No relaxation	BDL (DL - 0.001
32	restaurant de la companya del companya del companya de la companya	mg/l	IS 3025 (Part 2): 2019	1.0	No relaxation	BDL (DL - 0.01)
-	Lead (as Pb)	mg/l	IS 3025 (Part 2): 2019	0.01	No relaxation	BDL (DL - 0.001)
33	Manganese (as Mn)	mg/l	IS 3025 (Part 2): 2019	0.1	0.3	BDL (DL - 0.05)
34	Mercury (as Hg)	mg/l	IS 3025 (Part 48): 1994	0.001	No relaxation	BDL (DL - 0.0005
35	Molybdenum (as Mo)	mg/l	IS 3025 (Part 2): 2019	0.07	No relaxation	BDL (DL - 0.01)
36	Nickel (as Ni)	mg/l	IS 3025 (Part 2): 2019	0.02	No relaxation	BDL (DL - 0.01)
37	Selenium (as Se)	mg/l	IS 3025 (Part 56): 2003	0.01	No relaxation	BDL (DL- 0.001)
38	Silver (as Ag)	mg/l	IS 13428 : 2005	0.1	No relaxation	BDL (DL - 0.001)
39	Total Chromium (as Cr)	mg/l	IS 3025 (Part 2): 2019	0.05	No relaxation	BDL (DL - 0.03)
40	Zinc (as Zn)	mg/l	IS 3025 (Part 2): 2019	5	15	BDL (DL - 0.1)
SMITH	The same of the sa	1112/1	m 5025 (1 mt 2) , 2017		12)	DDL (DL " U.1)



Details of Salient Features

Page 2 of 4

			-			Page 2 of 4
s.n.	Test Parameter	Measurement Unit	Test Method	Require IS 105 (Drinking Wat Including Ar Acceptable	Test Result	
				Limit	Permissible Limit #	
1	Biological Testing 1. Water		Water Company of the			The state of the s
1	Total coliform	Per 100 ml	IS 15185 ; 2016	Absent	Absent	Absent
2	Escherichia coli	Per 100 ml	IS 15185 : 2016	Absent	Absent	Absent
127	Chemical Testing 1. Water		AND THE RESERVE OF THE PARTY OF			
3	Alkalinity (as CaCO ₂)	mg/l	IS 3025 (Part 23): 1986	200	600	101.34
4	Ammonia (as N)	mg/l	IS 3025 (Part 34): 1988	0.5	No relaxation	BDL (DL - 0.1)
5	Anionic surface active agents (as MBAS)	mg/l	IS 13428: 2005 Annex K	0.2	1.0	BDL (DL - 0.01)
6	Colour	Hazen units	IS 3025 (Part 4): 1983	. 5	15	1
7	Cyanide (as CN)	mg/l	IS 3025 (Part 27): 1986	0.05	No relaxation	BDL (DL - 0.005
8	Chloride (as CI)	mg/l	IS 3025 (Part 32):1988	250	1000	32.64
9	Calcium (as Ca)	mg/l	IS 3025 (Part 40): 1991	75	200	41.52
10	Chloramines (as Cl;)	mg/l	IS 3025 (Part 26): 1986	4.0	No relaxation	BDL (DL - 0.1)
11	Free residual chlorine	mg/l	IS 3025 (Part 26): 1986	Min. 0.2	1	BDL (DL - 0.1)
12	Fluoride (as F)	mg/l	IS 3025 (Part 60): 2008	1.0	1,5	0.24
13	Magnesium (as Mg) Nitrate (as NO:)	mg/l	IS 3025 (Part 46): 1994	30	100	7.16
15	Odour Odour	mg/l	APHA 23 rd Edition	45	No relaxation	BDL (DL - 2)
16	pH		IS 3025 (Part 5): 2018 IS 3025 (Part 11): 1983	Agreeable	Agreeable	Agreeable
17	Phenolic compounds (as	mg/l	IS 3025 (Part 11): 1983	6.5 to 8.5 0.001	No relaxation 0.002	7.73 at 25°C BDL (DL - 0.001
18	C _c H ₂ OH) Sulphate (as SO ₄)			0.000		Herman Annual Control
19	Sulphide (as H-S)	mg/l	IS 3025 (Part 24): 1986	200	400	16.92
20	Taste	mg/l	1S 3025 (Part 29): 1986	0.05	No relaxation	BDL (DL - 0.03)
21	Total dissolved solids	mg/l	IS 3025 (Part 8): 1984 IS 3025 (Part 16): 1984	Agreeable	Agreeable	Agreeable
22	Turbidity	NTU	IS 3025 (Part 10): 1984	500	2000	188
23	Total hardness (as CaCO ₃)	mg/l	IS 3025 (Part 21): 2009	200	600	0.3 133.20
24	Mineral Oil	mg/l	ANgr RES-40	0.5	No relaxation	BDL (DL - 0.001
11	Chemical Testing 2. Residues In Water		7814 860 10		And Television	BDL (DL - 0.001
25	Arsenic (as As)	mg/l	IS 3025 (Part 37): 1988	0.01	No relaxation	BDL (DL - 0.01
26	Aluminium (as Al)	mg/l	IS 3025 (Part 2): 2019	0.03	0.2	BDL (DL - 0.01
27	Barium (as Ba)	mg/l	IS 3025 (Part 2): 2019	0.7	No relaxation	BDL (DL - 0.01
28	Boron (as B)	mg/l	IS 3025 (Part 2): 2019	0.5	2.4	BDL (DL - 0.1)
29	Copper (as Cu)	mg/l	IS 3025 (Part 2): 2019	0.05	1.5	BDL (DL - 0.03
30	Cadmium (as Cd)	mg/l	IS 3025 (Part 2): 2019	0.003	No relaxation	BDL (DL - 0.00
31	Iron (as Fe)	mg/l	IS 3025 (Part 2): 2019	1.0	No relaxation	BDL (DL - 0.0)
32	Lead (as Pb)	mg/l	IS 3025 (Part 2): 2019	0.01	No relaxation	BDL (DL - 0.00
33	Manganese (as Mn)	mg/l	IS 3025 (Part 2): 2019	0.1	0.3	BDL (DL - 0.05
34	Mercury (as Hg)	mg/l	IS 3025 (Part 48): 1994	0.001	No relaxation	
35	Molybdenum (as Mo)		IS 3025 (Part 2): 2019	0.001	No relaxation	BDL (DL - 0.000
36	Nickel (as Ni)	mg/l	IS 3025 (Part 2): 2019			BDL (DL - 0.01
37	LONG CONTRACTOR AND CONTRACTOR CO	mg/l		0.02	No relaxation	BDL (DL - 0.01
-	Selenium (as Se)	mg/l	IS 3025 (Part 56): 2003	0.01	No relaxation	BDL (DL- 0.00)
38	Silver (as Ag)	mg/l	IS 13428 : 2005	0.1	No relaxation	BDL (DL - 0.00
39	Total Chromium (as Cr)	mg/l	IS 3025 (Part 2): 2019	0.05	No relaxation	BDL (DL - 0.03
40	Zinc (as Zn)	mg/l	IS 3025 (Part 2): 2019	5	15	BDL (DL - 0.1)



Details of Salient Features

TEST RESULTS

Page 3 of 4

S.N.	Test Parameter	Measurement Unit	Test Method	Requirement as per IS 10500: 2012 (Drinking Water Specifications) Including Amendment No. 2		Test Result					
				Acceptable Limit	Permissible Limit #						
п	Chemical Testing 2. Residues in Water										
41	Polychlorinated biphenyls										
	2,2',5-trichlorobiphenyl	µg/l	Angr RES - 31	0.5	No relaxation	BDL (DL - 0.03)					
	2,4,4'-trichlorobiphenyl	ид/1	Angr RES - 31	0.5	No relaxation	BDL (DL - 0.03)					
	2,2',5,5'-tetrachlorobiphenyl	μg/l	Angr RES - 31	0.5	No relaxation	BDL (DL - 0.03)					
	2,2',4,5,5'-pentachlorobiphenyl	µg/l	Angr RES - 31	0.5	No relaxation	BDL (DL - 0.03)					
	2,2',3,4,4',5'-hexachlorobiphenyl 2,2',4,4',5,5'-hexachlorobiphenyl	ив∕л	Angr RES - 31	0.5	No relaxation	BDL (DL - 0.03)					
	2,2',3,4,4',5,5'-heptachlorobiphenyl	ивл	Angr RES - 31	0.5	No relaxation	BDL (DL - 0.03)					
42	Polynuclear aromatic hydrocarbon	µg/	Angr RES - 31	0.5	No relaxation	BDL (DL - 0.03)					
7.55	Naphthalene	уду	ANgr RES - 30	0.1	No selection T	DDI (DI DAI)					
	Acenaphthylene	µg/l	ANGERES - 30	0.1	No relaxation No relaxation	BDL (DL - 0.03)					
	Acenaphthene	µg/l	ANgr RES - 30	0.1	No relaxation No relaxation	BDL (DL - 0.03) BDL (DL - 0.03)					
	Fluorene	µg/l	ANgr RES - 30	0.1	No relaxation No relaxation	BDL (DL - 0.03)					
	Anthracene	µg/l	ANgr RES - 30	0.1	No relaxation	BDL (DL - 0.03)					
	Phenanthrene	μg/l	ANgr RES - 30	0.1	No relaxation	BDL (DL - 0.03)					
	Fluoranthene	μg/l	ANgr RES - 30	0.1	No relaxation	BDL (DL - 0.03)					
	Pyrene	μg/1	ANgr RES - 30	0.1	No relaxation	BDL (DL - 0.03)					
	Benzo(a)anthracene	μg/l	ANgr RES - 30	0.1	No relaxation	BDL (DL - 0.03)					
	Chrysene	µg/l	ANgr RES - 30	0.1	No relaxation	BDL (DL - 0.03)					
	Benzo(a)pyrene	μg/1	ANgr RES - 30	0.1	No relaxation	BDL (DL - 0.03)					
	Benzo(b)fluoranthene	µg/l	ANgr RES - 30	0.1	No relaxation	BDL (DL - 0.03)					
	Benzo(k)fluoranthene	μg/l	ANgr RES - 30	0,1	No relaxation	BDL (DL - 0.03)					
	Indeno(123,od)pyrene	μg/l	ANgr RES - 30	0.1	No relaxation	BDL (DL - 0.03)					
	Dibenzo(a,h)anthracene	µg∕1	ANgr RES - 30	0.1	No relaxation	BDL (DL - 0.03)					
-	Benzo(ghi)perylene	µg/l	ANgr RES - 30	0.1	No relaxation	BDL (DL -0.03)					
43	Trihalomethanes	100				100000000000000000000000000000000000000					
1	Bromoform	mg/l		0.1	No relaxation	BDL (DL -0.05)					
ii	Dibromochloromethane	mg/l	APHA 6232	0.1	No relaxation	BDL (DL -0.05)					
iii	Bromodichloromethane	mg/l	23 rd Edition	0.06	No relaxation	BDL (DL -0.05)					
iv	Chloroform	mg/l		0.2	No relaxation	BDL (DL -0.05)					
44	Pesticide Residues Organochlor				XI						
i	Alpha-HCH	μg/l	ANqr RES-28	0.01	No relaxation	BDL (DL - 0.01					
íi	Beta HCH	μg/1	ANqr RES-28	0.04	No relaxation	BDL (DL - 0.03)					
iii	Gamma - HCH (Lindane)	μg/1	ANgr RES-28	2	No relaxation	BDL (DL - 0.03)					
iv	Delta- HCH	µg/l	ANgr RES-28	0.04	No relaxation	BDL (DL - 0.03)					
v	Alachlor	μg/l	ANgr RES-29	20	No relaxation	BDL (DL - 0.03)					
vi	Aldrin	µg/l	ANgr RES-28	0.03	No relaxation						
vii	Dieldrin			0.03		BDL (DL - 0.03)					
viii	Butachlor	µg/l	ANqr RES-28 ANqr RES-29		No relaxation	BDL (DL - 0.03)					
-	4	µg/l		125	No relaxation	BDL (DL - 0.03					
1X	p,p'-DDE	µg/1	ANgr RES-28	1	No relaxation	BDL (DL - 0.03)					
X	o,p'-DDE	µg/l	ANgr RES-28	1	No relaxation	BDL (DL - 0.03					
xi	p,p'-DDD	µg/l	ANgr RES-28		No relaxation	BDL (DL - 0.03)					
XII	o,p'-DDD	µg/l	ANqr RES-28	1	No relaxation	BDL (DL - 0.03)					
xiii	o,p'- DDT	μg/l	ANgr RES-28	1	No relaxation	BDL (DL - 0.03)					
xiv	p,p'- DDT	μg/l	ANgr RES-28	1	No relaxation	BDL (DL - 0.03)					
XV	Endosulphan	W. The state of th		vi							
	Alpha-Endosulphan		Harris Proposition								
	Beta-Endosulphan	μg/l	ANqr RES-28	0.4	No relaxation	BDL (DL - 0.03)					
	Endosulphan sulphate		- 10	.M. T.							



Details of Salient Features

TEST RESULTS

Page 4 of 4

S.N.	Test Parameter	Measurement Unit	Test Method	Requirement as per IS 10500 : 2012 (Drinking Water Specifications) Including Amendment No. 2		Test Result
				Acceptable Limit	Permissible Limit #	
44	Pesticide Residues Organophosph	orus				
xvi	2,4-Dichlorophenoxyacetic acid	µg/l	ANgr RES-29	30	No relaxation	BDL (DL - 0.03)
xvii	Monocrotophos	µg/l	ANgr RES-29	1	No relaxation	BDL (DL - 0.03)
xviii	Atrazine	μg/l	ANgr RES-29	2	No relaxation	BDL (DL - 0.03)
xix	Parathion methyl	µg/l	ANgr RES-29	0.3	No relaxation	BDL (DL - 0.03)
XX	Paraoxon methyl	µg/l	ANqr RES-29	1		BDL (DL - 0.03)
XXI	Isoproturon	µg/l	ANgr RES-29	9	No relaxation	BDL (DL - 0.03)
xxii	Malathion	μg/l	ANgr RES-29	190	No relaxation	BDL (DL - 0.03)
xxiii	Malaoxon	μg/l	ANgr RES-29		-	BDL (DL - 0.03)
xxiv	Ethion	μg/1	ANgr RES-29	3	No relaxation	BDL (DL - 0.03)
XXV	Chlorpyrifos	μg/l	ANgr RES-29	30	No relaxation	BDL (DL - 0.03)
xxvi	Phorate		ANqr RES-29		No relaxation	
	Phorate-sulfone	μg/1		2		BDL (DL - 0.03)
	Phorate-sulfoxide					

NOTES: • Please see watermark "Original Test Report" to confirm the authenticity of this report. • Results shall be referred to tested sample(s) and applicable to tested parameters only. • Test report shall not be reproduced except in full without prior written approval of Anacon Labs. • Liability of Anacon Labs is limited to invoiced amount only. • Non-perishable and perishable sample(s) shall be disposed off after 30 days and 15 days respectively from the date of issue of Test Report, unless specified otherwise. • #Permissible limit in absence of an alternate source for drinking water, • 'mg/l' is equivalent to 'ppm' • 'µg/l' is equivalent to 'ppb' • BDL- Below detection limit. • DL- DL Indicates detection limit of instrument /method and shall be considered as 'absent'. • Result for test no. 11 is not relevant. • ANqr RES-28, 29, 30, 31 & 40 : Inhouse validated method.

REMARKS: As requested by the client, sample was tested for above parameters only. Sample complies with IS:10500:2012, for tests conducted, indicating that it is fit for drinking purpose with respect to tested parameters.

----END OF REPORT-



Details of Salient Features

Table 8

Report on Soil Analysis, Samri Sampling Date: 19/05/2021

Sample Location: (Rajendrapur/Nr.Mining Area)

TEST RESULTS

(Page 1 of 2)

S.N.	Test Parameter	Measurement Unit	Test Method	Test Resul				
1	Infiltration rate	mm/hr	Lab/SOP	16.46				
2	Bulk density	g/cm ³	Lab/SOP	1.527				
3	Water holding capacity	%	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	23.68				
4	Particle size distribution							
	Sand	%	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India	45.94				
	Silt	%	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India	31.52				
	Clay	%	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India	22.54				
5	Texture		Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India	Loam				
6	pH (1:2.5 Aq. Extract) at 25°C		Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	6.91 at 25%				
7	Electrical Conductivity (1:2.5 Aq. Extract)	μs/cm	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	417,24				
8	Water soluble Calcium (as Ca)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	206,59				
9	Water soluble Magnesium (as Mg)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	164.38				
10	Water soluble Sodium (as Na)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	304.51				
11	Water soluble Potassium (as K)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	121.68				
12	Water soluble Chloride (as Cl)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	152,47				
13.	Water soluble Sulphate (as SO4)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	304.82				
14	Exchangeable Sodium (as Na)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	121.68				
15	Exchangeable Potassium (as K)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	52.81				
16	Exchangeable Calcium (as Ca)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India) Method Manual, Soil testing in India	116.65				
17	Exchangeable Magnesium (as Mg)	mg/Kg	(Department of agriculture & corporation, Govt of India)	104.29				
18	Sodium adsorption ratio		By Calculation	22:16				
19	Total Organic matter	%	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	3.32				
20	Total Organic Carbon	%	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	1.76				
21	Available Nitrogen (as N)	Kg/hec	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	204.94				



Details of Salient Features

	Test Parameter	lac .	(Page 2 of 2)				
S.N.		Measurement Unit	Test Method	Test Resul			
22	Available Phosphorous (as P)	Kg/hec	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	11,28			
23	Available Potassium (as K)	Kg/hec	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	121.67			
24	CEC	meq/100g	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	6			
25	Arsenic (As)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	Absent			
26	Boron (B)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	0.13			
27	Cadmium (Cd)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	Absent			
28	Chromium (Cr)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	Absent			
29	Copper (Cu)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	2.86			
30	Lead (Pb)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	Absent			
31	Nickel (Ni)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	Absent			
32	Cobalt (Co)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	0.17			
33	Iron (Fe)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	6.84			
34	Manganese (Mn)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	13.19			
35	Zinc (Zn)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	0.21			
36	Selenium (Se)	mg/Kg	Method Manual, Soil testing in India (Department of agriculture & corporation, Govt of India)	Absent			

NOTES: Please see watermark "Original Test Report" to confirm the authenticity of this report. • Results shall be referred to tested sample(s) and applicable to tested parameters only. Test report shall not be reproduced except in full without prior written approval of Anacon Labs. Liability of Anacon Labs is limited to invoiced amount only. • Non-perishable and perishable sample(s) shall be disposed off after 30 days and 15 days respectively from the date of issue of Test Report, unless specified otherwise • 'g/100 g' is equivalent to '%w/w' • 'mg/kg' is equivalent to 'ppm'. OND indicates not detectable.

Remarks: As requested by the client, sample was tested for above parameters only.

-End of Report-



Details of Salient Features

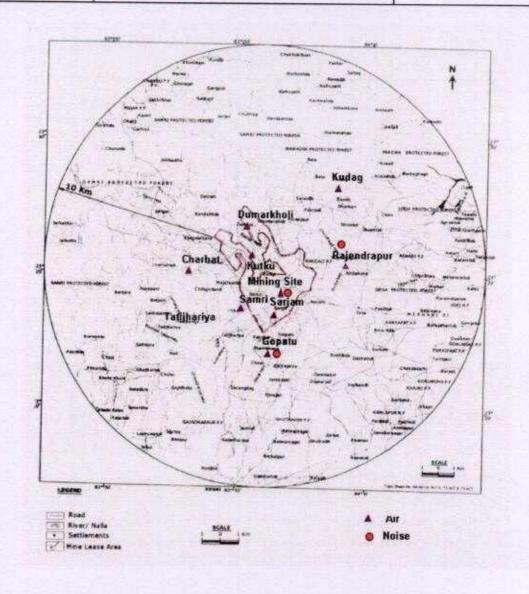


Fig3: Sampling Locations for Air, Noise



Details of Salient Features

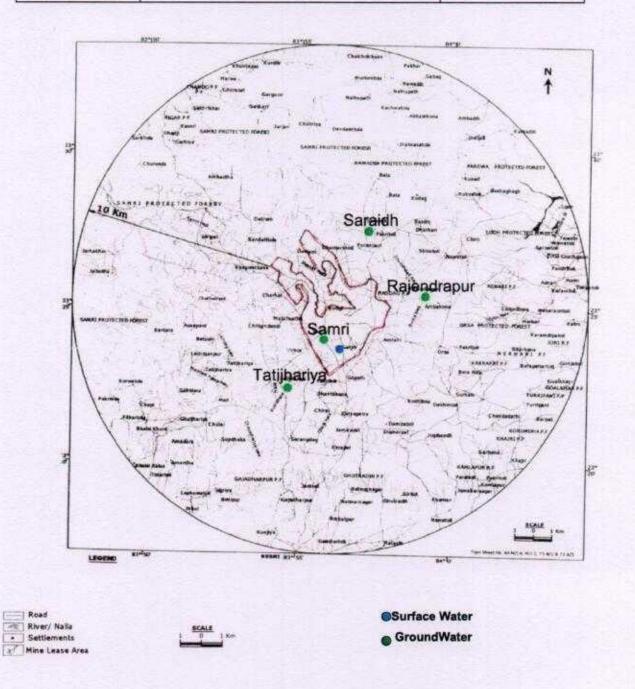


Fig 04: Sampling Locations for Water